



Precision Plumbing Products

“Specify with Confidence - Install with Pride”

SYSTEM RATED PLUS WATER HAMMER ARRESTORS

PPP WATER HAMMER ARRESTORS ARE SPECIFIED FOR MANY INSTALLATIONS!

ONLY ONE MOVING PART!

SIZED IN ACCORDANCE WITH SERVICE PIPE DIMENSION


SYSTEM-RATED PLUS

Water Hammer Arrestors are specified for commercial, industrial and residential uses.

A maintenance-free installation is assured when using this type of arrestor...the only moving part is the free-moving piston furnished with “O”ring seals which have been tested for reliability in excess of normal operating ranges.

FLUID HAMMER IN FLUID TRANSMISSION LINES – a definition.

Fluid Hammer is a series of hydraulic shock waves generated within the confines of a piping system due to the sudden stopping of fluid flow. This condition is caused by fast closing of positive valves incorporated within the system. The effect of fluid hammer is damaging if allowed to exist for any length of time and will result in broken pipes and damage to other components in the system.

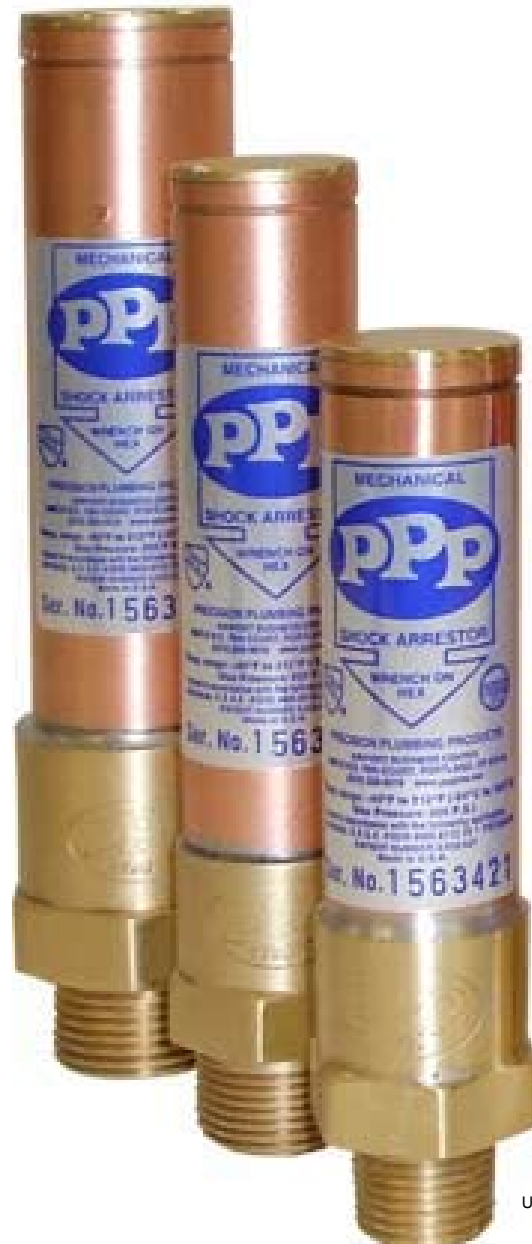

U.S. Patent No. 3,633,627

40 Years
of outstanding performance



SPECIFICATIONS & INSTALLATIONS

INSTALLATION: May be installed in new or existing plumbing systems with a standard pipe tee.
 MAINTENANCE: Maintenance free – the piston is the only moving part.
 TEMPERATURE RANGE: -40°F to + 212°F (-4.4°C to + 100°C)
 CONSTRUCTION: Barrel-fabricated of type “L” hard drawn copper. Cap: Machined of free turning brass, attached to barrel with 95-5 solder.
 Piston and threaded adapter: Machined of free turning brass.
 Seals: “O”rings: EPDM.
 Seal Lubricant: Dow-Corning Silicone Compound #111, FDA listed for use in potable water systems.
 Nickel Plated: For Salt Water Application.
 OPERATING PRESSURE: Designed to operate on all domestic and commercial systems. Normal operating pressure 0 to 200 P.S.I.G., Max spike Pressure 400 P.S.I.G.

PDI SIZING AND SELECTION TABLE

PIPE SIZE	FIXTURE UNITS	CROSS REF. PDI
1/2"	1-11	A
3/4"	12-32	B
1"	33-60	C

Extract from: PDI WH201-06

NO ACCESS PANEL REQUIRED.
(CONSULT LOCAL CODE)

PROJECT SUBMITTAL

Project: _____
 Contractor: _____
 Engineer: _____
 Date Submitted: _____
 Prepared By: _____

SIZING INFORMATION

For equipment and fixtures not listed below, size in accordance with load values (WSFU) assigned the same. Extract from: PDI WH201-06

FIXTURE	TYPE OF SUPPLY CONTROL	WEIGHT IN FIXTURE UNITS			
		Public		Private	
		C.W.	H.W.	C.W.	H.W.
Water Closet	Flush Valve	8	-	5	-
Water Closet	Flush Tank	5	-	2.5	-
Pedestal Urinal	Flush Valve	4	-	-	-
Stall or Wall Urinal	Flush Valve	4	-	-	-
Stall or Wall Urinal	Flush Tank	2	-	-	-
Lavatory	Faucet	1 1/2	1 1/2	1	1
Bathhtub	Faucet	2	3	1 1/2	1 1/2
Shower Head	Mixing Valve	2	3	1	2
Bathroom Group	Flush Valve Closet	-	-	8	3
Bathroom Group	Flush Tank Closet	-	-	6	3
Separate Shower	Mixing Valve	-	-	1	2
Service Sink	Faucet	3	3	-	-
Laundry Tubs (1-3)	Faucet	-	-	3	3
Comb. Fixture	Faucet	-	-	3	3



DIMENSIONAL AND AIR LOADING DATA

A O.A.L.	B N.P.T.	NITROGEN PRELOAD PSI	PART NUMBER
5"	1/2" brass	60	SC-500
6"	3/4" brass	60	SC-750
6 3/4"	1" brass	60	SC-1000



Precision Plumbing Products
 Division of JL Industries, Inc.

Airport Business Center
 6807 NE 79th Court, Suite E
 Portland, Oregon 97218

T (503) 256-4010
 F (503) 253-8165

www.pppinc.net